


Advantex™ Treatment System


AX 20 Series - Mode 3b



Orengo Systems®
Incorporated

Water Tight Tankage Spec.

It Is Necessary That Tanks Be Vacuum Or Water Tested To Certify Water Tight Tankage. PVC Acces Risers Must Be Water Tight, Epoxied To Tankage And Bolted Down For Liability Consideration. Contractor/Tank Manufacturer Shall Be Responsible For Repair Or Replacement Of Tanks With Leaks or Defects.

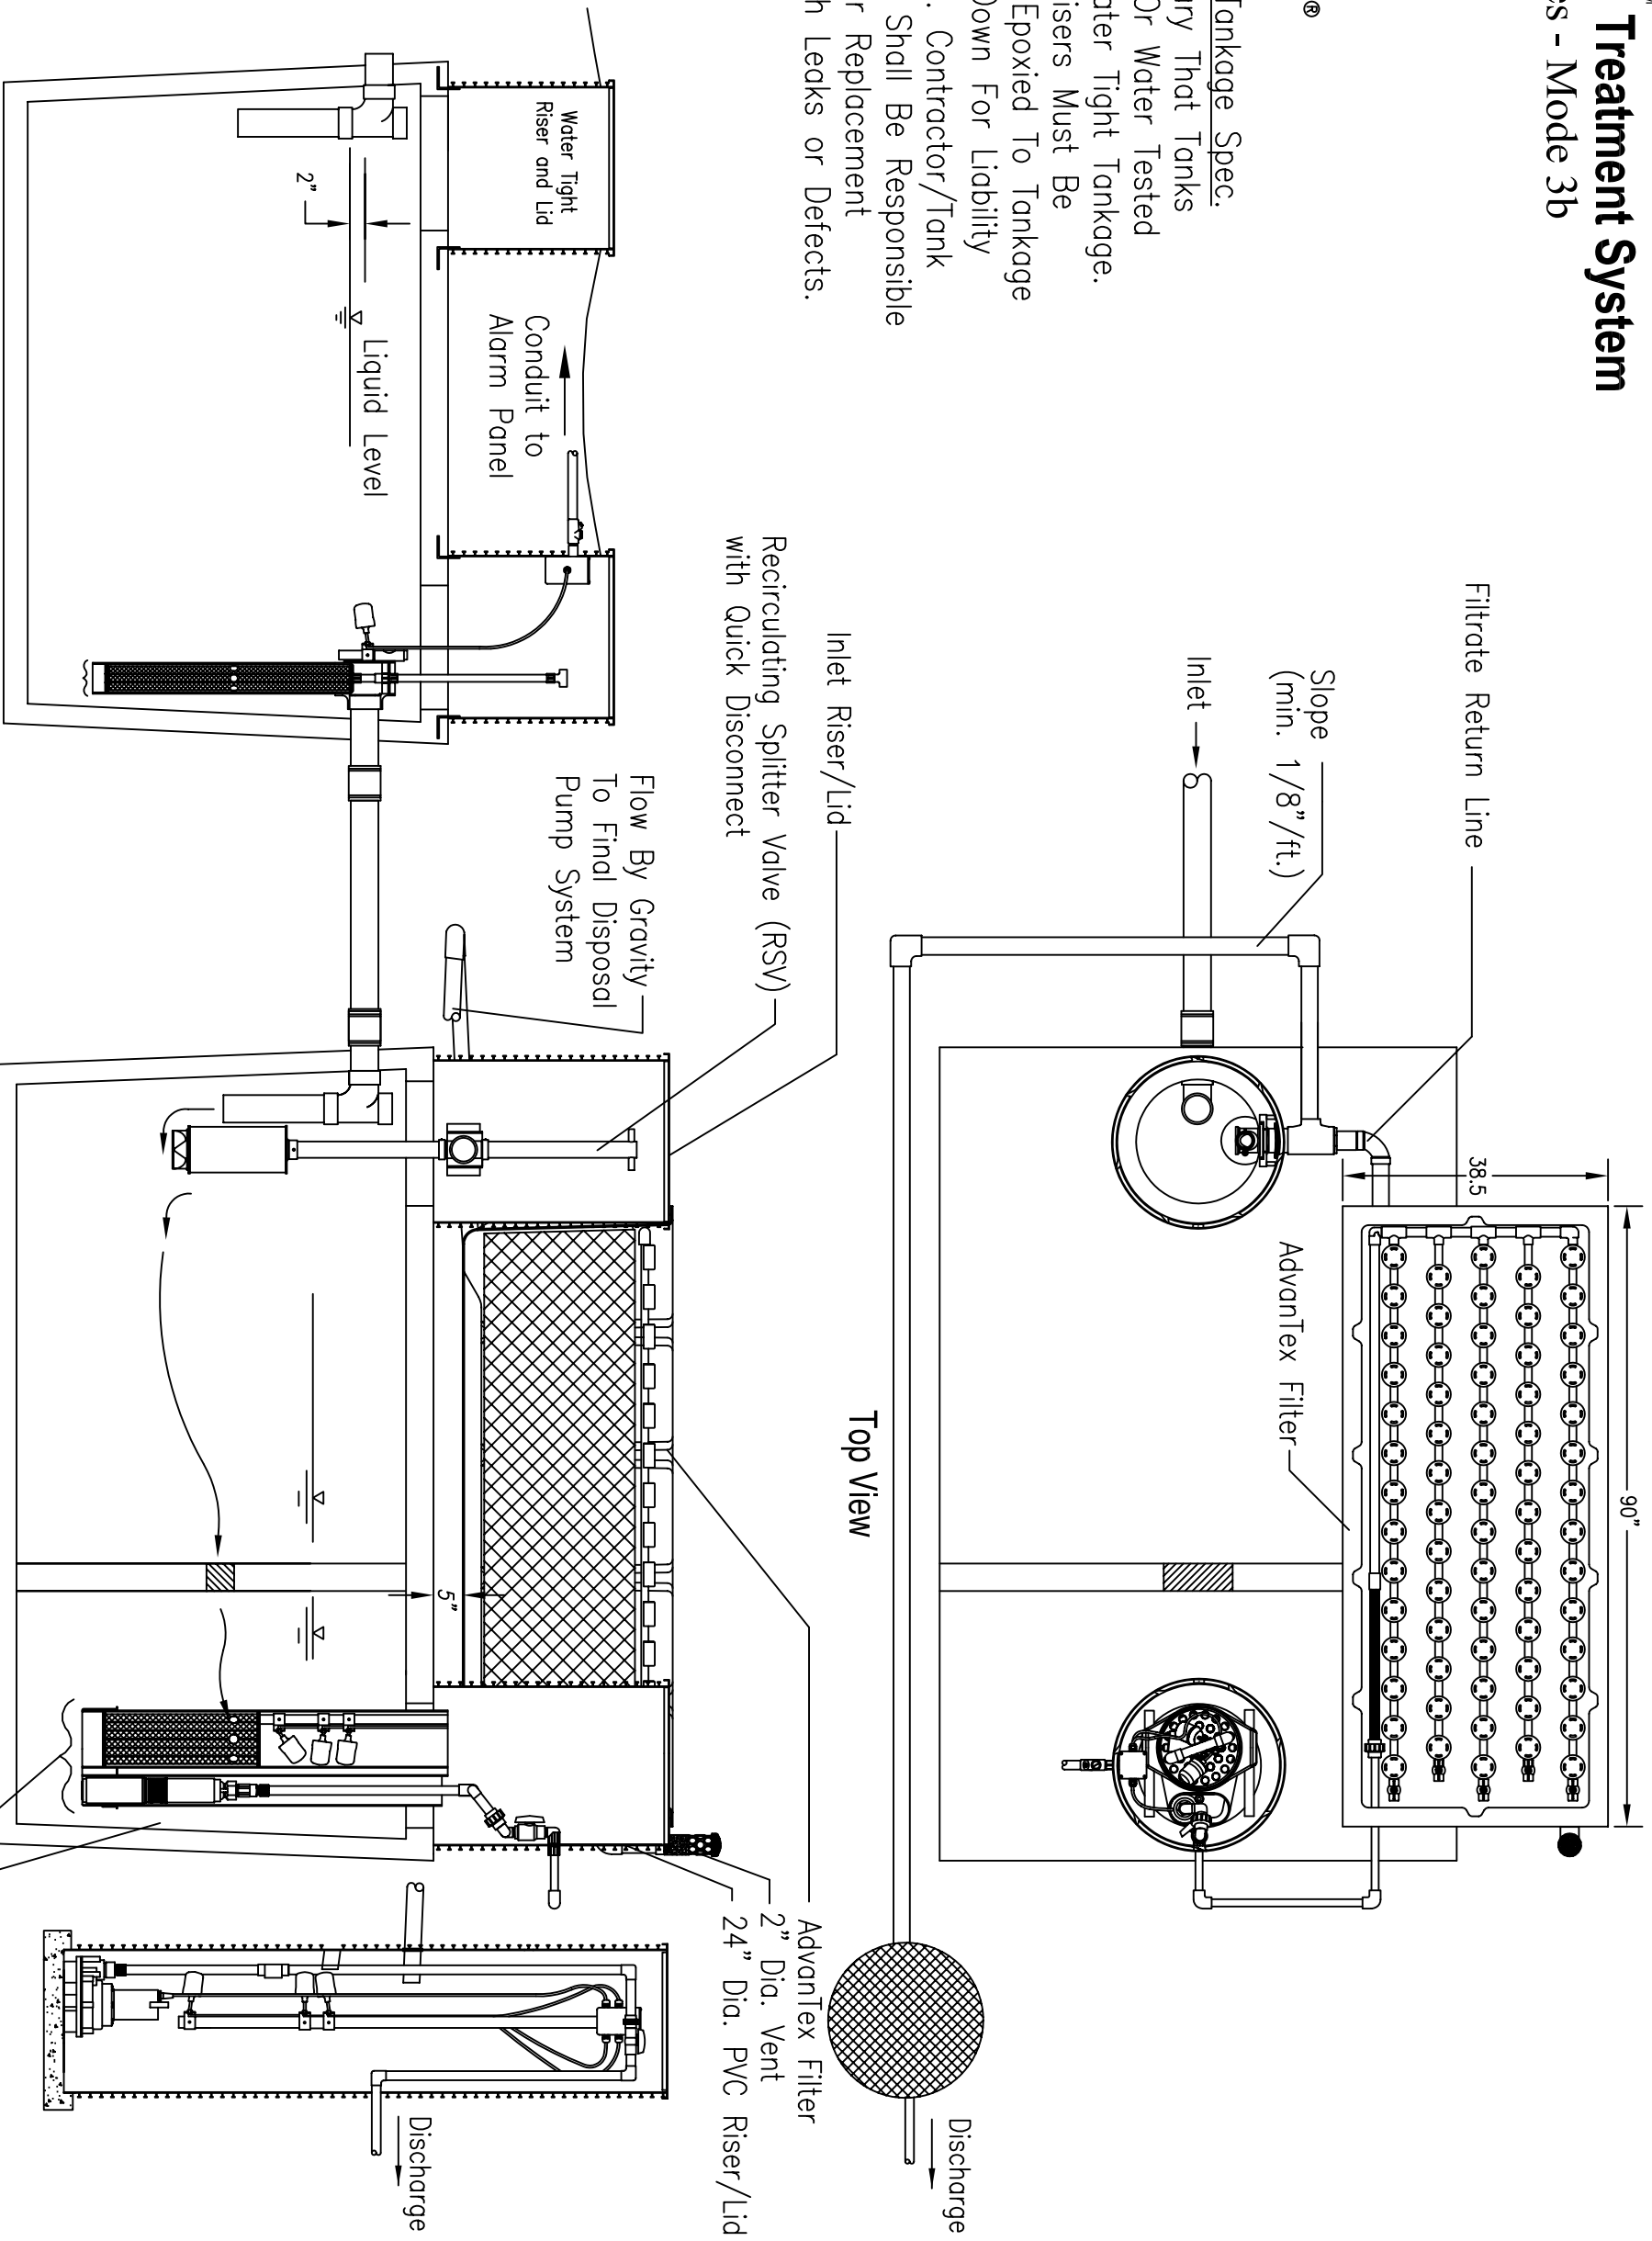

Patents # 4,439,323 & 5,492,635
Foreign Patents Pending
©Orengo Systems, Inc.

DRAWN	ADL
SCALE	
DATE	12/14/02
APPROVED	

7125 East Pickard Road
P. O. Box 309
Mt. Pleasant, MI 48804-0309
ph-989-773-9938
fax-989-772-3415



NO	REVISION	DATE	BY
1			
2			
3			
4			
5			

SHEET	OF
1	1
DRAWING NO. A20	