

AdvanTex™ Treatment System



AX 20 Series - Mode 3a

Water Tight Tankage Spec.

It Is Necessary That Tanks Be Vacuum Or Water Tested To Certify Water Tight Tankage. PVC Acces Risers Must Be Water Tight, Epoxied To Tankage And Lids Bolted Down For Liability Consideration. Contractor/Tank Manufacturer Shall Be Responsible For Repair Or Replacement Of Tanks With Leaks or Defects. Tankage Must Have 3 Year Warranty.



Orenco Systems
Incorporated

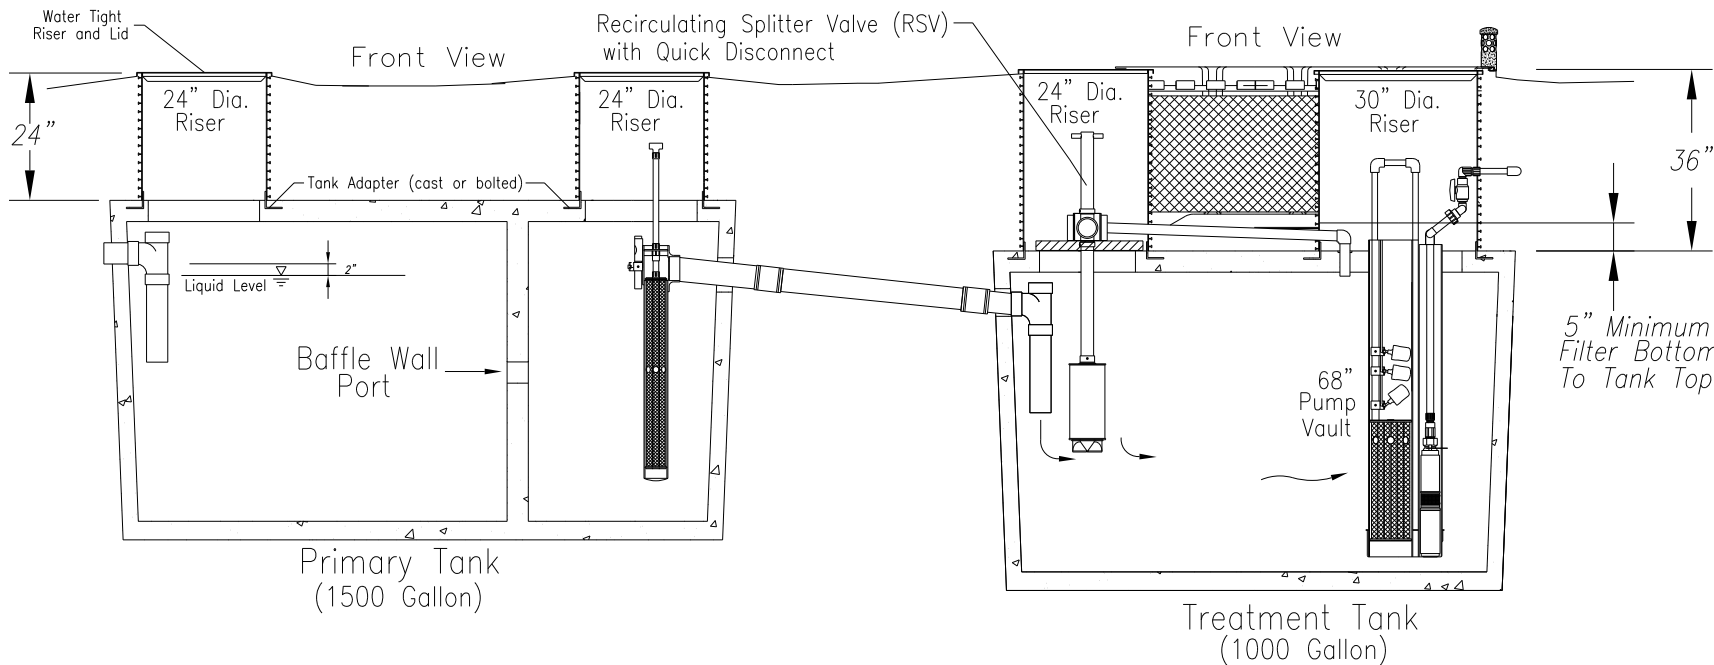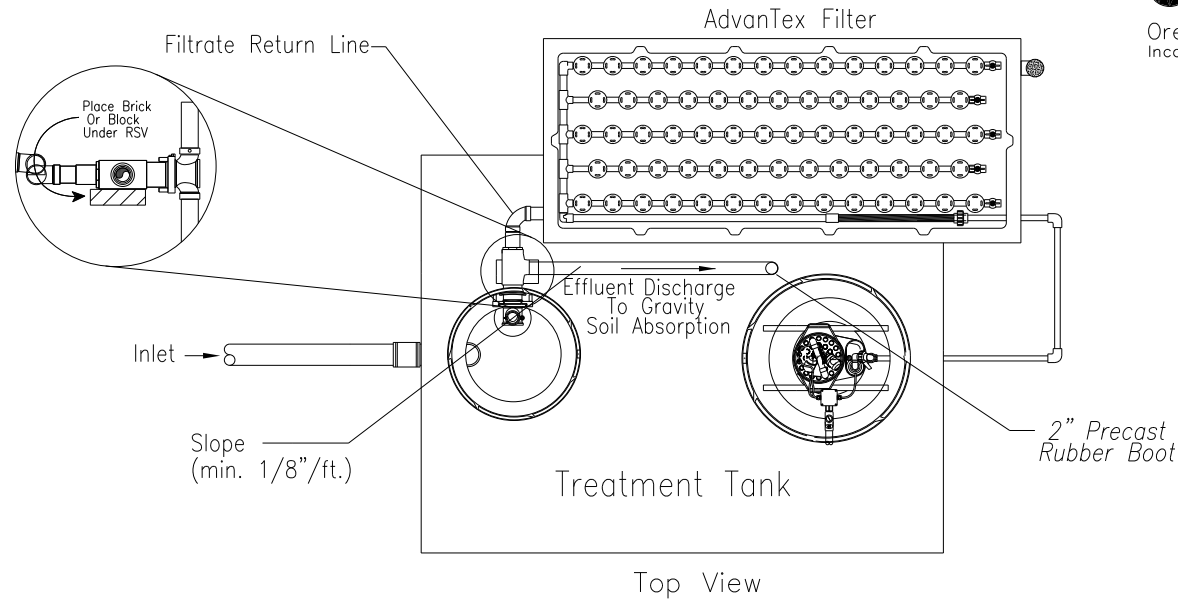

DRAWN	jd
SCALE	
DATE	12/20/04
APPROVED	

7125 East Pickard Road
P. O. Box 309
Mt. Pleasant, MI 48804-0309
ph-989-773-9938
fax-989-772-3415



BY	jd
DATE	
REVISION	12/04
NO	1 2 3 4 5

SHEET	1 OF 1
-------	--------

DRAWING NO.	AX-G+
-------------	-------

Patents # 4,439,323 & 5,492,635
Foreign Patents Pending
© Orenco Systems, Inc.

AdvanTex Ax-20a Gravity Dispersal

AX 20 a 1500 1000