


# Splice Box Wiring Detail

(2 Float System)  
(float activated pump with  
a high level alarm panel)

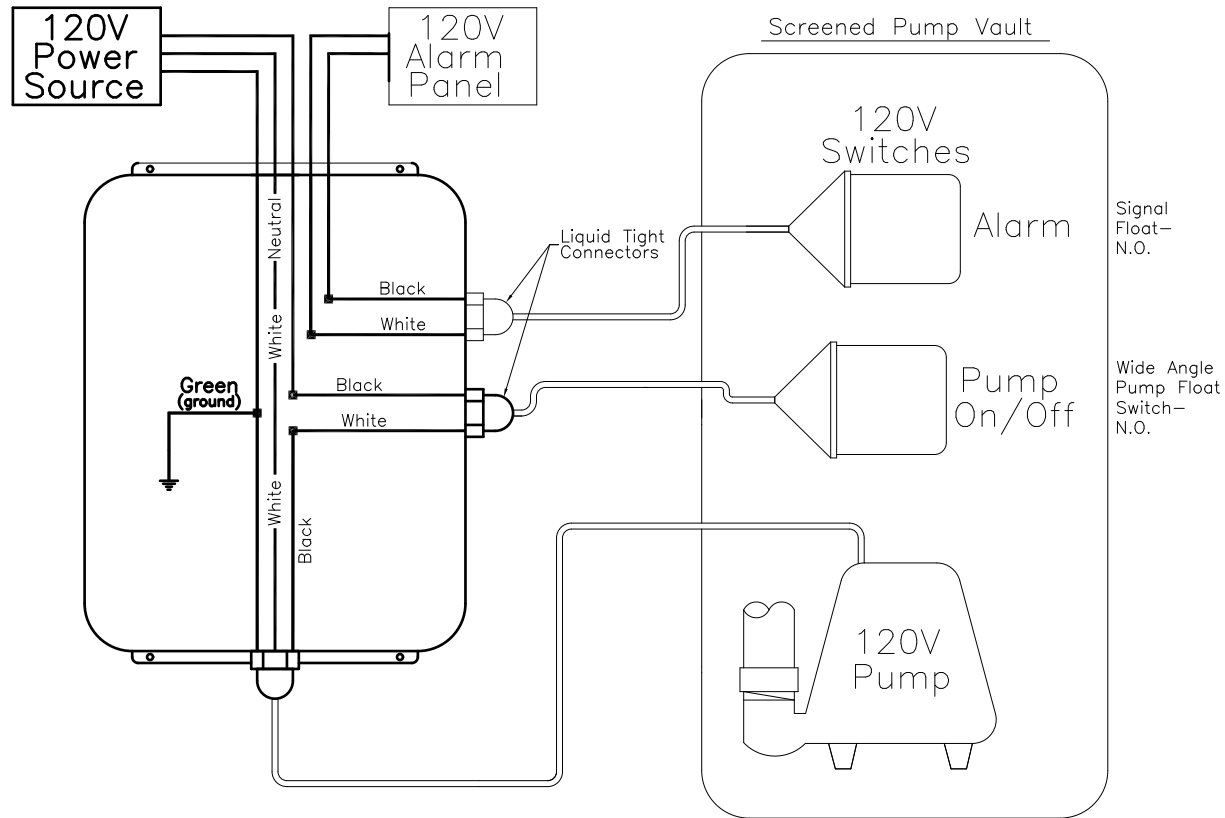

## Notes:

- Floats Are Not Preset For Pumping Levels
- Conduit Seal-Off Outside Of Riser
- Heat Shrink Connectors, Or Silicone Filled Wire Nuts Should Be Used

DRAWING NO. FL2	SHEET OF 1	NO	REVISION	DATE	BY		DRAWN	jdu
		1.	12/04		jdu		SCALE	
		2.					DATE	12/20/04
		3.					APPROVED	
		4.						
		5.						
7125 East Pickard Road P. O. Box 309 Mt. Pleasant, MI 48804-0309 ph-989-773-9938 fax-989-772-3415								