




Orenco Systems[®]
Incorporated

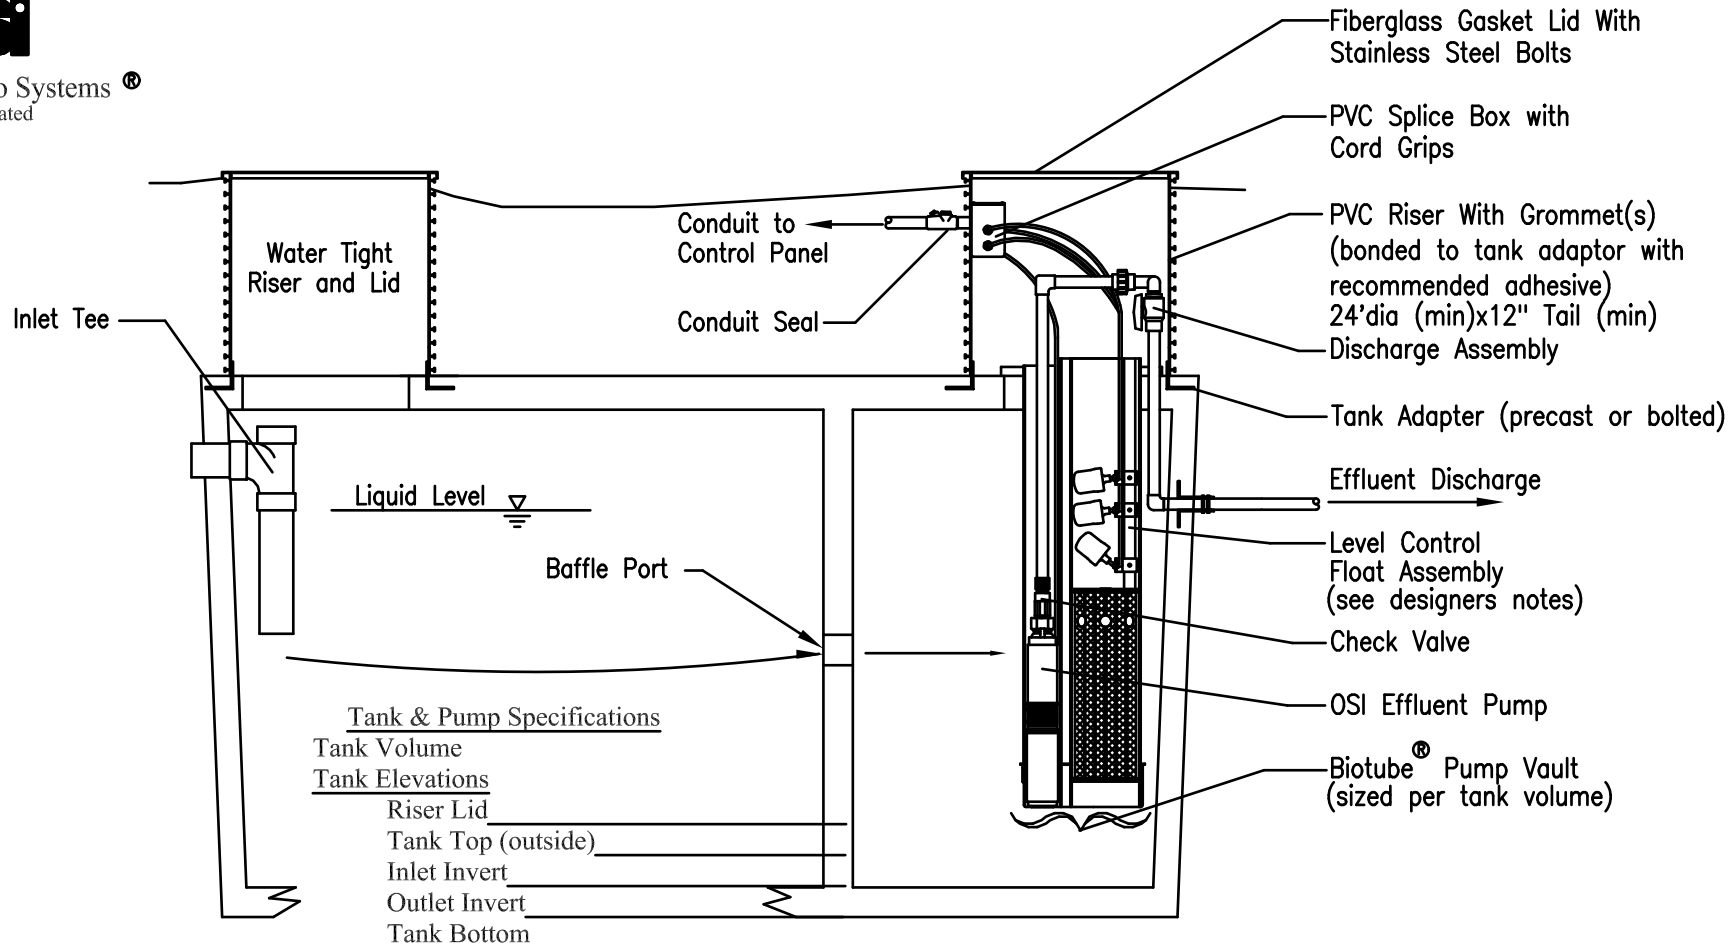

Tank & Pump Specifications

- Tank Volume _____
 Tank Elevations _____
 Riser Lid _____
 Tank Top (outside) _____
 Inlet Invert _____
 Outlet Invert _____
 Tank Bottom _____

Pump Description

- Make _____
 Model _____
 GPM @ TDH _____
 HP _____
 Voltage/Phase _____
 Dose Volume _____
 Pump Vault Model _____
 Discharge Assembly Model _____
 Float Model _____
 Control Panel Model _____

Water Tight Tankage Spec.
 It is Necessary That Tanks Be Vacuum Or Water Tested To Certify Water Tight Tankage. PVC Access Risers Must Be Water Tight, Epoxied To Tankage And Lids Bolted Down For Liability Consideration. Contractor/Tank Manufacturer Shall Be Responsible For Repair Or Replacement Of Tanks With Leaks or Defects.

Patents # 4,439,323 & 5,492,635
 Foreign Patents Pending
 ©Orenco Systems, Inc.

STEP System
 Septic Tank Effluent Pump
 Model: STEP HH PV (2 Comp Tanks)

DRAWN	jdu
SCALE	
DATE	12/20/04
APPROVED	

7125 East Pickard Road
 P. O. Box 309
 Mt. Pleasant, MI 48804-0309
 ph-989-773-9938
 fax-989-772-3415



NO	REVISION	DATE	BY
1.	12/04		jdu
2.	12/21/2007		SLB
3.			
4.			
5.			

SHEET 1 OF 1

DRAWING NO.
S1A